


REVISIONS			
REV.	DESCRIPTION	DATE	APPROVED
0	INITIAL ISSUE	11-11-11	JPW

CPEZPXXXXXX

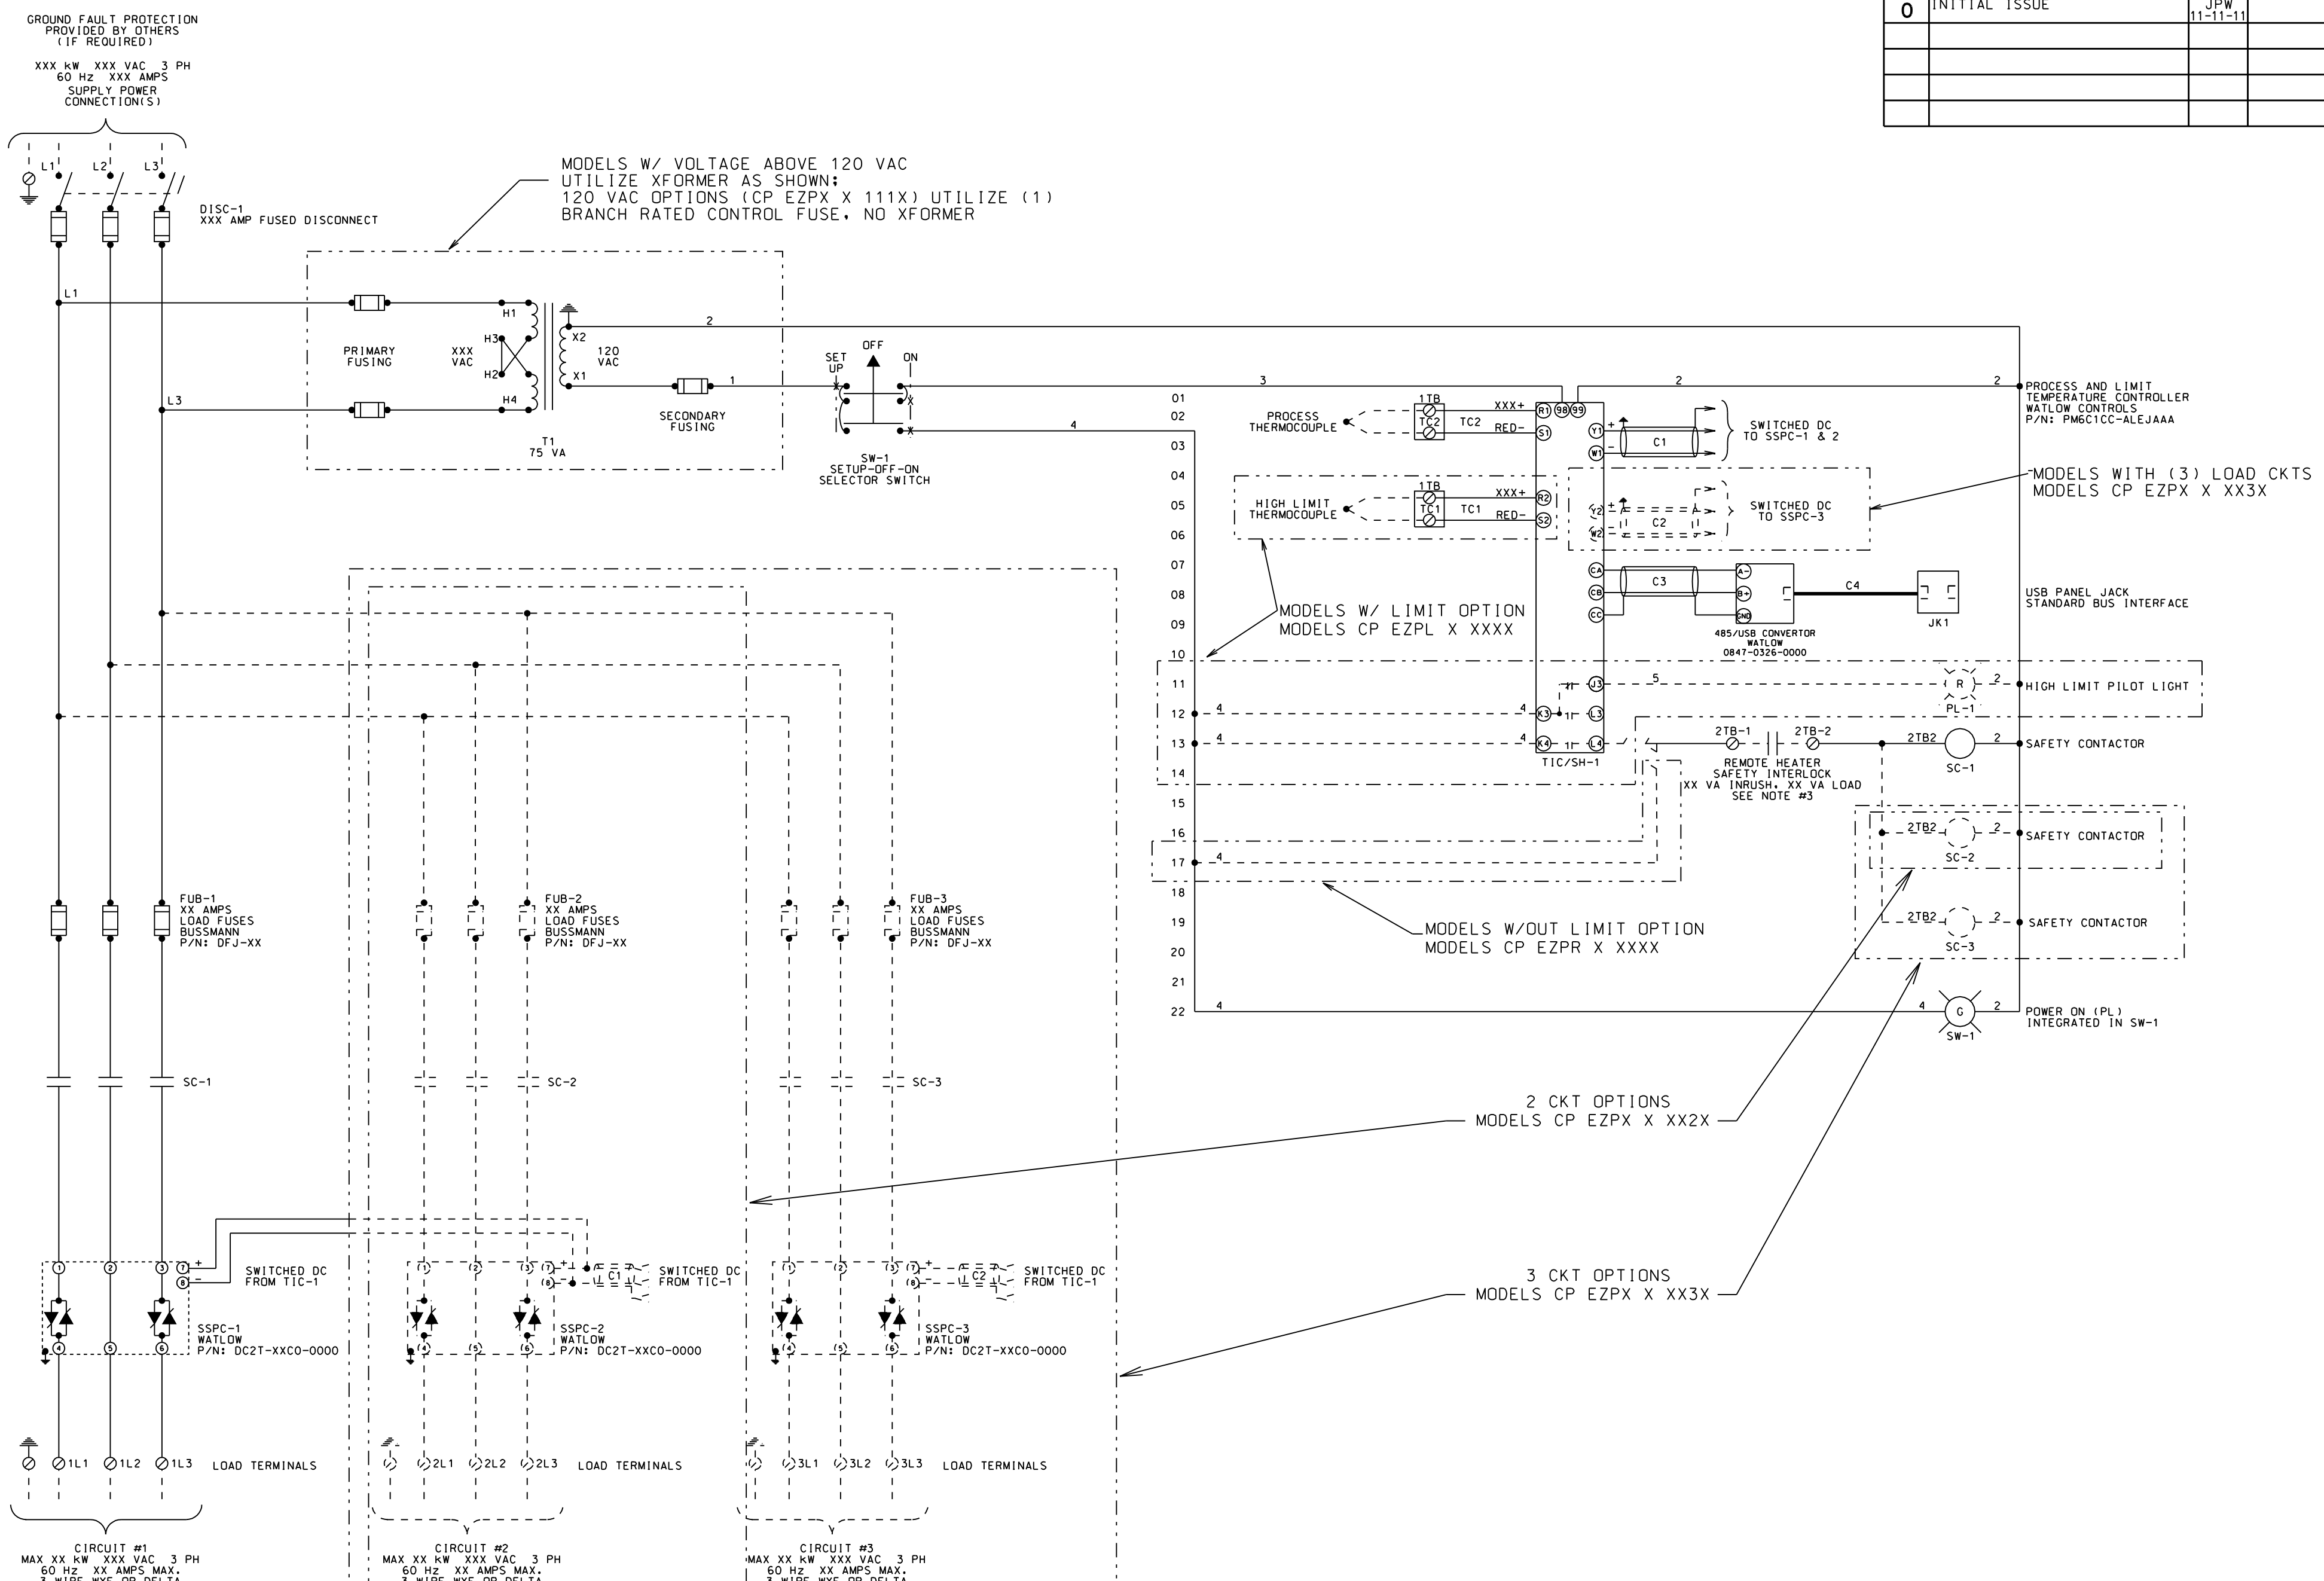

CU WIRE ONLY
60°C INSULATION 100 AMPS OR LESS
75°C INSULATION 100 AMPS OR MORE

SUPPLY & LOAD CONDUCTORS TO BE SIZED SUCH THAT
IT IS SUITABLE FOR THE PROVIDED OVERCURRENT PROTECTION.

USE CONDUIT FITTINGS WITH THE SAME
ENVIRONMENTAL RATINGS AS THE ENCLOSURE

WIRING BY WATLOW
FIELD WIRING BY OTHERS

KEY

- SC = SAFETY CONTACTOR
- FUB = FUSE BLOCK
- SSPC = SOLID STATE POWER CONTROLLER
- PB = PUSH BUTTON
- SW = SELECTOR SWITCH
- TIC = TEMPERATURE CONTROLLER
- TSH = TEMPERATURE SHEATH HIGH
- I2T = SEMICONDUCTOR FUSE
- #TB = TERMINAL BLOCK

NOTE: DO NOT SCALE DRAWING

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES	DRAWN J.P.W.	DATE 11-11-11
.X = ± 0.1 .XX = ± 0.06 .XXX = ± 0.031 .XXXX = ± 0.0050 ANGLES = ± 2 FRACTIONS = ± /	CHECKED	DATE
	ENGRG	DATE
	O.A.	DATE

WATLOW ELECTRIC MANUFACTURING COMPANY CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN. DISCLOSED, IT IS SUPPLIED IN CONFIDENCE, WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF WATLOW, AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WATLOW'S WRITTEN PERMISSION.

WATLOW - HANNIBAL
(AN OPERATING UNIT OF WATLOW MISSOURI)
#6 INDUSTRIAL LOOP ROAD, HANNIBAL MO 63401
PHONE 573-221-2816, FAX 573-221-3723

TITLE
EXAMPLE WIRING DIAGRAM
STANDARD CONTROL PANEL

CUSTOMER	SIZE C	CAGE CODE	DWG NO CPEZPXXXXXX	REV 0
CAD NO.	MAT'L	SCALE NONE	PART NO CPEZPXXXXXX	SHEET 1 OF 1